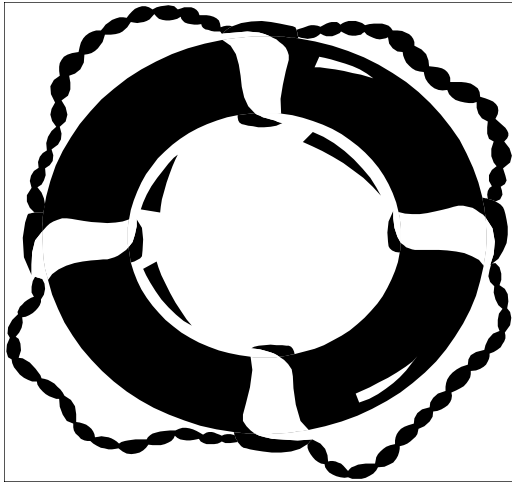

Sparta Swimming Pool Requirements



City Building Ordinance 14-81

- (a) Installation. All private pools shall be installed in accordance with manufacturers instructions.
- (b) Maintenance. All private pools shall be maintained in accordance with manufacturers instructions.
- (c) Restricted access. All pools, whether installed above or below grade, shall be enclosed by a wall or fence at least 48" high and of such construction as to make access difficult. Entrances through this enclosure shall be through self closing gates, designed to be difficult to open by an unattended child. Pool walls may serve as the required wall if the pool enclosure is a min. 48" above

grade and access is difficult for an unattended child.

(d) Permit Required

REMEMBER:
1. Installation
2. Maintenance
3. Restricted access
4. Permit required.

National Electric Code Article 680

- (1) Receptacles on the property shall be located at least 10' from the inside walls of a pool. (Exception: Receptacles that provide power for water-pump motors for a permanently installed pool, as permitted between 5 and 10 feet from the inside walls of the pool, and where so located shall be single and of the locking and grounding types and shall be protected by GFCIs.)
- (2) Where a permanently installed pool is installed at a dwelling unit, at least one 125 volt convenience receptacle shall be located a minimum of 10 feet from and not more than 20 feet from the inside wall of the pool.

- (3) All 125 volt receptacles located within 20 feet of the inside walls of a pool shall be protected by GFCIs.
- (4) Underground wiring shall not be permitted under a pool or within the area extending 5 feet horizontally from the inside wall of the pool. (Exception: Wiring necessary to supply pool equipment permitted by this article shall be allowed within this area. Also, when space limitations prevent wiring from being routed 5 feet or more from the pool, such wiring shall be permitted when installed in rigid metal conduit, intermediate metal conduit, or a non-metallic raceway system. All metal conduit shall be corrosion resistant and suitable for the location

State Plumbing Code SPS 82.41

- (1) Protection of potable water supply.
- (a) General. Potable water supply systems shall be designed, installed and maintained in such manner as to prevent contamination from non potable water supply through cross connections or any other piping connections.

If you have any questions regarding these codes, call the City Building Inspection Department.
